

VISKON-AIRE

Air Filter Products

PAINT ARRESTANCE FILTER TEST REPORT

Spray Removal Efficiency & Paint Holding Capacity

BASED ON 40 CFR PART 63 NATIONAL EMISSION STANDARD

Tested for: **Viskon-Aire**
 Filter Mfr.: **Viskon-Aire**
 Filter Name: **107X**
 Report#./Test#: **R503 T603**
 Report Date: **January 6, 2010**

Test Information

FILTER DESCRIPTION:

Blue Fiberglass on white backing

PAINT DESCRIPTION:

High Solids Baking Enamel (S.W. #1 Permaclad 2400, red)

PAINT SPRAY METHOD:

Conventional Air Gun at 40 PSI

SPRAY FEED RATE:

144 gr./min. **135** cc./min.

AIR VELOCITY:

150 FPM

Test Results

INITIAL PRESSURE DROP of Clean Test Filter

0.02 in. water

FINAL PRESSURE DROP of Loaded Test Filter

0.20 in. water

WEIGHT GAIN on TEST FILTER & Test Frame Trough

3910 grams

PAINT HOLDING CAPACITY of TEST FILTER

1496 grams = **3.3** lbs.

PAINT RUN-OFF





2414 grams

WEIGHT GAIN on FINAL FILTER

49.4 grams = **PENETRATION**

AVERAGE REMOVAL EFFICIENCY of TEST FILTER

98.75 %

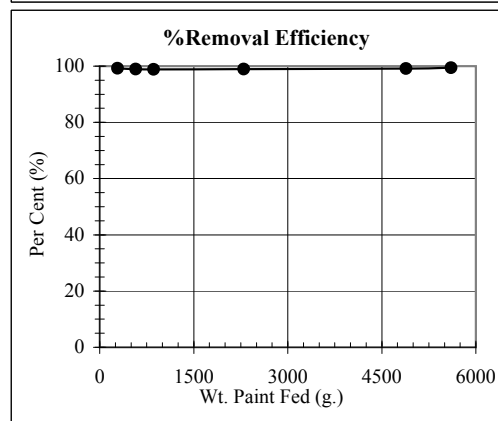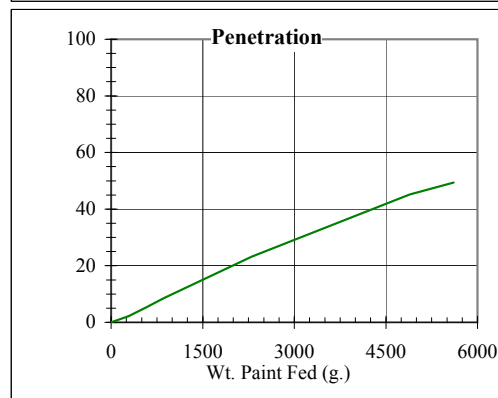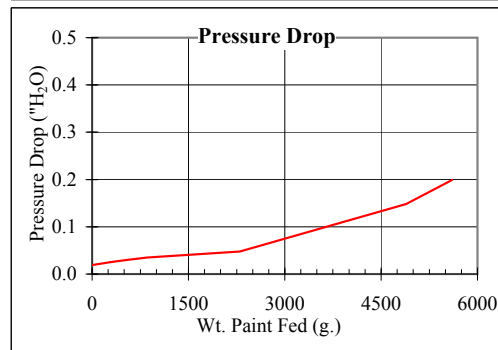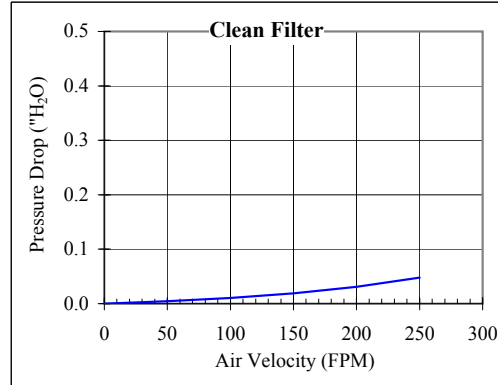

Test Engineer: Todd Kruger

Supervising Engineer: K. C. Kwok, Ph.D.